


NOTES:

- 1) BACKFLOW PREVENTION ASSEMBLY SHALL BE INSTALLED WITHIN 3 FEET OF THE IRRIGATION METER.
- 2) PIPE MATERIAL SHALL BE PVC (SCH 40 OR BETTER), COPPER (TYPE K) OR BRASS (ASTM B43).
- 3) IRRIGATION ASSEMBLIES TO BE DRAINED DURING WINTER MONTHS BY PROPERTY OWNER.
- 4) INSTALLATION SHALL BE IN COMPLIANCE WITH ALL APPLICABLE CITY OF SANFORD ORDINANCES AND SPECIFICATIONS IN ADDITION TO THE NC PLUMBING CODE.
- 5) PROPERTY OWNER SHALL BE RESPONSIBLE FOR MAINTENANCE AND OPERATION OF BACKFLOW PREVENTION ASSEMBLY AND COMPLIANCE WITH REPORTING AND TESTING REQUIREMENTS.

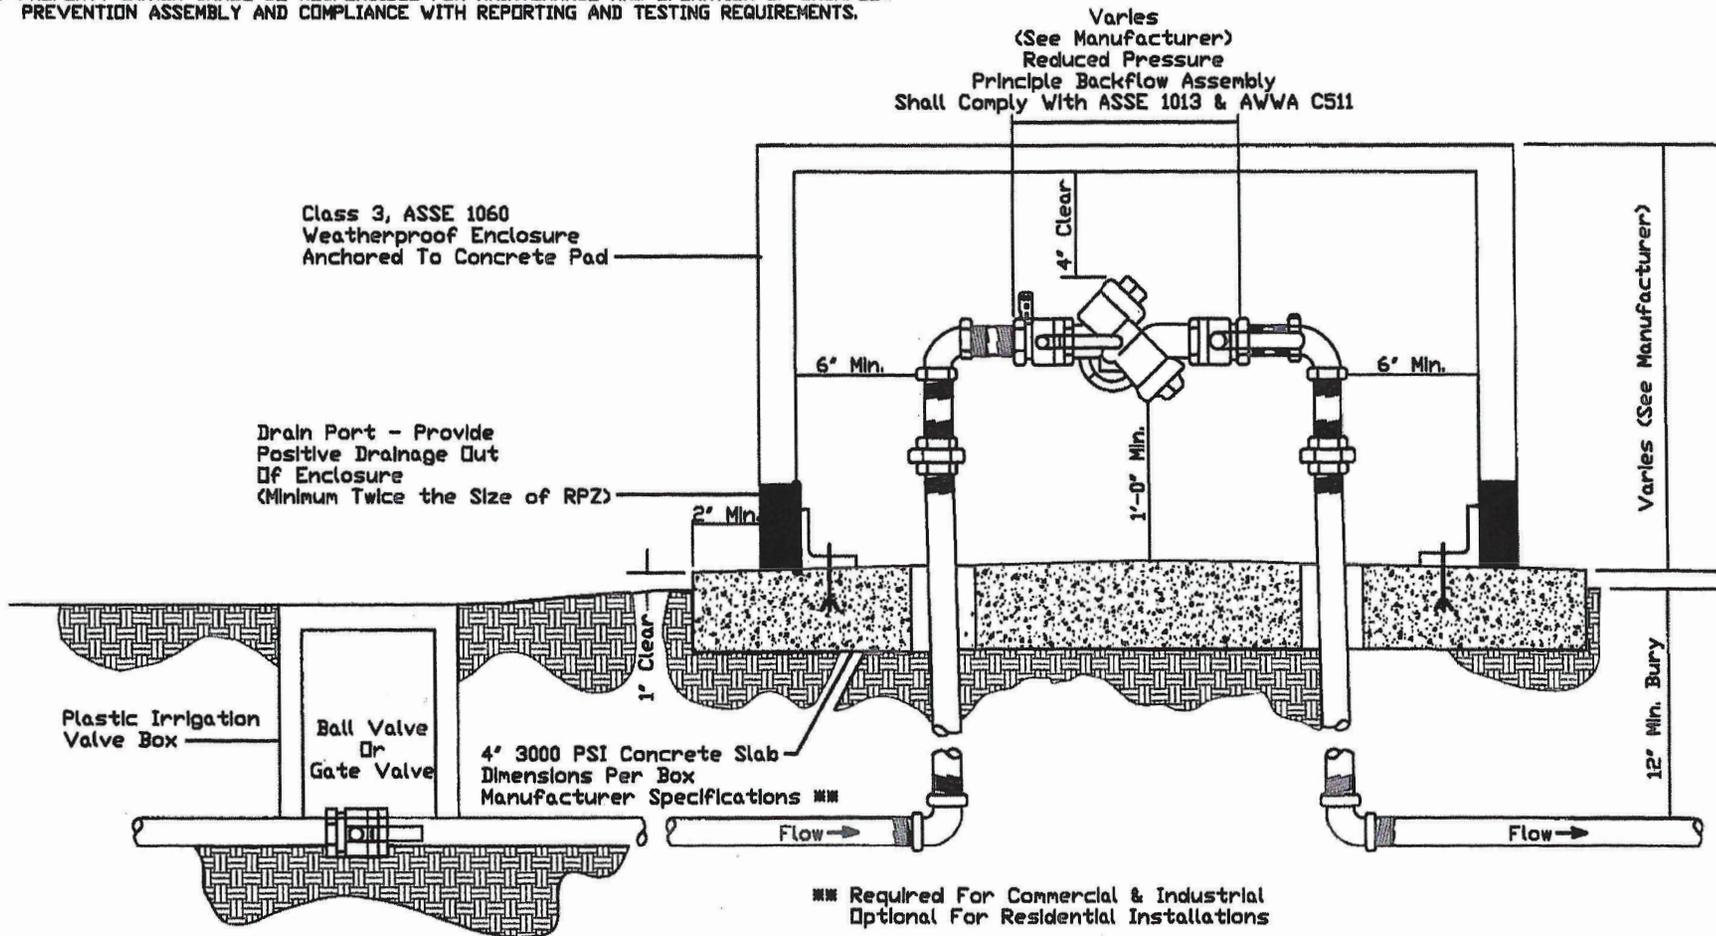

**STANDARD 3/4" TO 2" IRRIGATION SYSTEM
BACKFLOW PREVENTOR**

Scale: NTS

Date: 06/26/09

CAD BY: AMJ